



Farabaugh Engineering and Testing Inc.

Project No. T348-11

Report Date: December 16, 2011

Total Pages (inclusive): 10

**ASTM E330
STRUCTURAL PERFORMANCE TESTING**

**16" SIDING PANEL WITH CLIP
24 GA STEEL**

FOR


PETERSEN ALUMINUM CORP.
1005 TONNE RD.
ELK GROVE VILLAGE, IL 60007

Report Prepared By:

Patrick J. Farabaugh

Reviewed and Approved By:

Daniel G. Farabaugh



Project No. T348-11

Purpose

This test method covers the evaluation of structural performance of the referenced test specimen per ASTM E330-02, "Standard Test Method of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference" and as provided herein.

Test Dates

12-6-11 to 12-11-11

Test Specimen

Manufacturer: Petersen Aluminum Corp.
1005 Tonne Rd.
Elk Grove Village, IL 60007

Panel: 16" Siding Panel with Clip, 24 ga Steel

Testing Apparatus

A vacuum test chamber was used with two static pressure taps located at diagonally opposite corners. A controlled blower provided a vacuum to uniformly load the specimen mock-up. Calibrated manometers were used to measure the pressure at each pressure tap. The uniform load pressure was performed in the negative direction to monitor wind uplift on the panel specimen mock-up. Calibrated deflectometers were attached to monitor panel deformation as shown.

Project No. T348-11

Installation

- The panels were installed on to 16 ga supports using a fixed clip with #10-16 X 1” long pancake head self drill fasteners (2 screws per clip). The panel side-joints were a tongue and groove type as shown on the attached detail.
- Plastic (4 mil thick) was employed loosely between the panels and subgirts and in the side joints to create a vacuum seal.

Procedure

- The test assembly was subjected to negative pressures to form an outward pressure at the values and time duration as shown in the attached table.
- Each pressure increment was held for at least 1 minute.
- Deflection movement of the assembly during the tests was recorded.
- Successive increments were achieved as above until failure or ultimate load was reached.

TEST "A"

Specimen: 16" Siding Panel with Clip, 24 ga Steel

Clip Spacing: 4 ft o/c

NEGATIVE LOAD TEST

LOAD (PSF)	DEFLECTION READINGS (INCHES)							
	D-1	D-2	D-3	D-4	D-5	D-6	D-7	D-8
1.3	0	0	0	0	0	0	0	0
11.7	0.152	0.509	0.171	0.541	0.109	0.518	0.109	0.492
1.3	0	0.01	0.007	0.016	0.013	0.026	0.011	0.022
22.1	0.321	0.876	0.353	0.851	0.282	0.957	0.199	0.76
1.3	0.037	0.1	0.068	0.088	0.076	0.144	0.019	0.084
32.5	0.459	1.104	0.497	1.069	0.379	1.3	0.27	0.834
1.3	0.062	0.163	0.106	0.143	0.125	0.231	0.038	0.126
42.9	0.587	1.326	0.631	1.272	0.499	1.58	0.376	0.931
1.3	0.102	0.238	0.161	0.213	0.168	0.345	0.066	0.175
53.3	0.718	1.566	0.759	1.467	0.603	1.845	0.474	1.084
1.3	0.168	0.323	0.208	0.281	0.207	0.445	0.13	0.24
63.7	0.858	1.835	0.873	1.647	0.678	2.13	0.536	1.379
1.3	0.239	0.44	0.273	0.371	0.27	0.578	0.199	0.346

RESULTS:

Maximum Test Load = 74.3 psf (Panel disengaged from clip)

$$R_{(ult)} = [74.3 \text{ #/ft}^2 \times 4 \text{ ft}] = 297.2 \text{ #/ft}$$

$$F.S. = 2.0$$

$$R_{(allow)} = \underline{148.6 \text{ #/ft}}$$

$$R_{(ult)} = [74.3 \text{ #/ft}^2 \times 4 \text{ ft}] = 297.2 \text{ #/ft}$$

$$F.S. = 1.65$$

$$R_{(allow)} = \underline{180.1 \text{ #/ft}}$$

Project No. T348-11

TEST "B"

Specimen: 16" Siding Panel with Clip, 24 ga Steel

Clip Spacing: 1 ft o/c

NEGATIVE LOAD TEST

LOAD (PSF)	DEFLECTION READINGS (INCHES)							
	D-1	D-2	D-3	D-4	D-5	D-6	D-7	D-8
1.3	0	0	0	0	0	0	0	0
16.9	0.132	0.6	0.132	0.629	0.138	0.582	0.149	0.453
1.3	0.002	0.025	0.01	0.016	0.001	0.006	0	0.006
32.5	0.228	0.997	0.23	1.204	0.25	0.984	0.27	0.99
1.3	0.006	0.035	0.064	0.293	0.006	0.02	0.006	0.017
48.1	0.326	1.351	0.333	1.49	0.331	1.323	0.361	1.336
1.3	0.023	0.154	0.066	0.416	0.023	0.114	0.008	0.103
63.7	0.396	1.658	0.385	1.687	0.552	1.666	0.487	1.656
1.3	0.08	0.263	0.128	0.541	0.091	0.266	0.111	0.257
79.4	0.597	1.984	0.51	1.965	0.771	1.995	0.747	2.004
1.3	0.201	0.466	0.227	0.671	0.221	0.492	0.195	0.477
95.0	0.748	2.246	0.68	2.182	0.839	2.246	0.848	2.242
1.3	0.327	0.696	0.268	0.845	0.365	0.705	0.319	0.685
115.8	0.963	2.571	0.744	2.419	1.052	2.481	1.002	2.582
1.3	0.478	1.055	0.5	1.079	0.497	1.094	0.518	1.093
141.8	1.194	2.949	1.061	2.713	1.191	2.983	1.212	2.958
1.3	0.652	1.466	0.51	1.365	0.74	1.45	0.701	1.446
167.8	1.288	3.277	1.148	3.01	1.316	3.317	1.299	3.333
1.3	0.812	1.85	0.611	1.687	0.876	1.85	0.849	1.842
193.8	1.443	3.596	1.193	3.267	1.491	3.612	1.407	3.597
1.3	0.96	2.135	0.908	1.95	0.972	2.15	1.062	2.138
219.9	1.524	3.948	1.36	3.507	1.648	3.957	1.933	4.005
1.3	1.116	2.552	0.921	2.192	1.165	2.57	1.183	2.521

RESULTS:

Maximum Test Load = 334.1 psf (Panel sidejoint disengagement)

$$R_{(ult)} = [334.1 \text{ \#/ft}^2 \times 1 \text{ ft}] = 334.1 \text{ \#/ft}$$

$$F.S. = 2.0$$


$$R_{(allow)} = \underline{167.0 \text{ \#/ft}}$$

$$R_{(ult)} = [334.1 \text{ \#/ft}^2 \times 1 \text{ ft}] = 334.1 \text{ \#/ft}$$

$$F.S. = 1.65$$

$$R_{(allow)} = \underline{202.5 \text{ \#/ft}}$$


TEST "A"

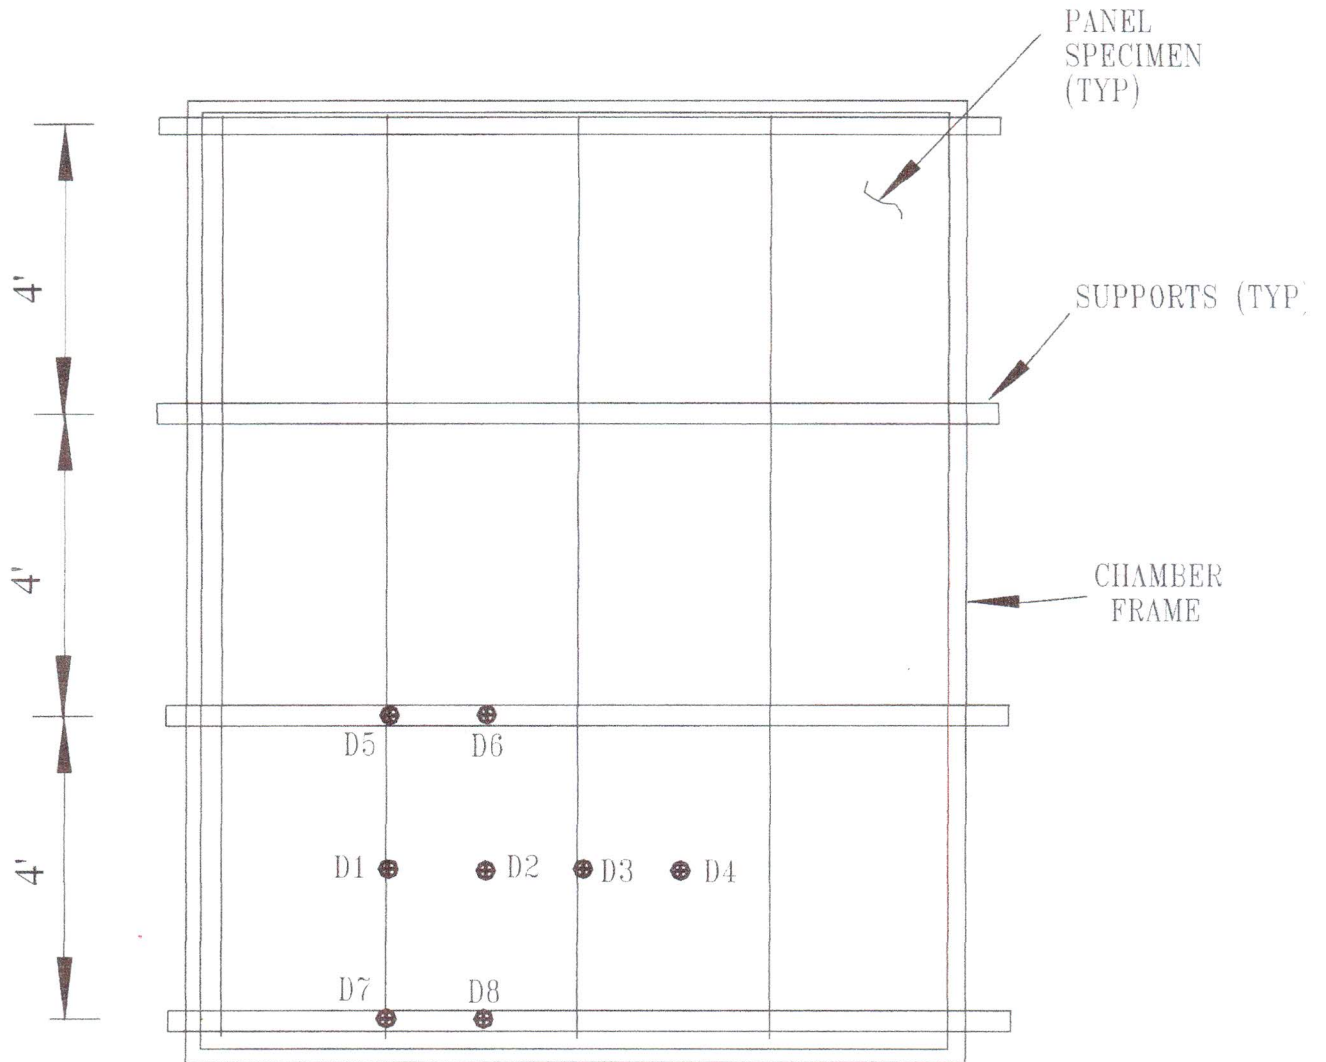

⊗ DEFLECTION POINT


TEST ASSEMBLY


TEST "B"

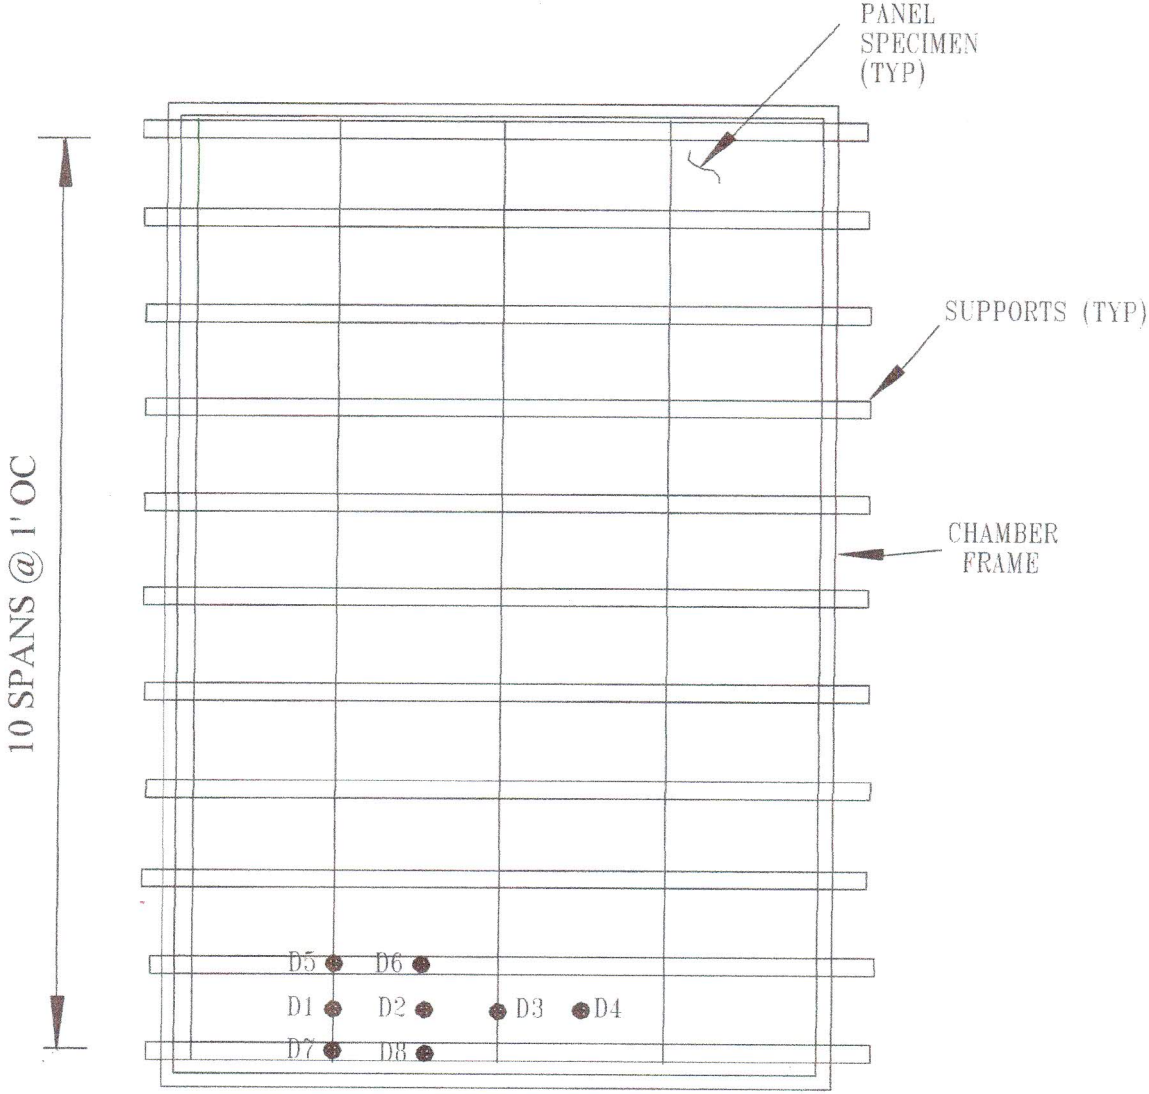

● DEFLECTION POINT

TEST ASSEMBLY

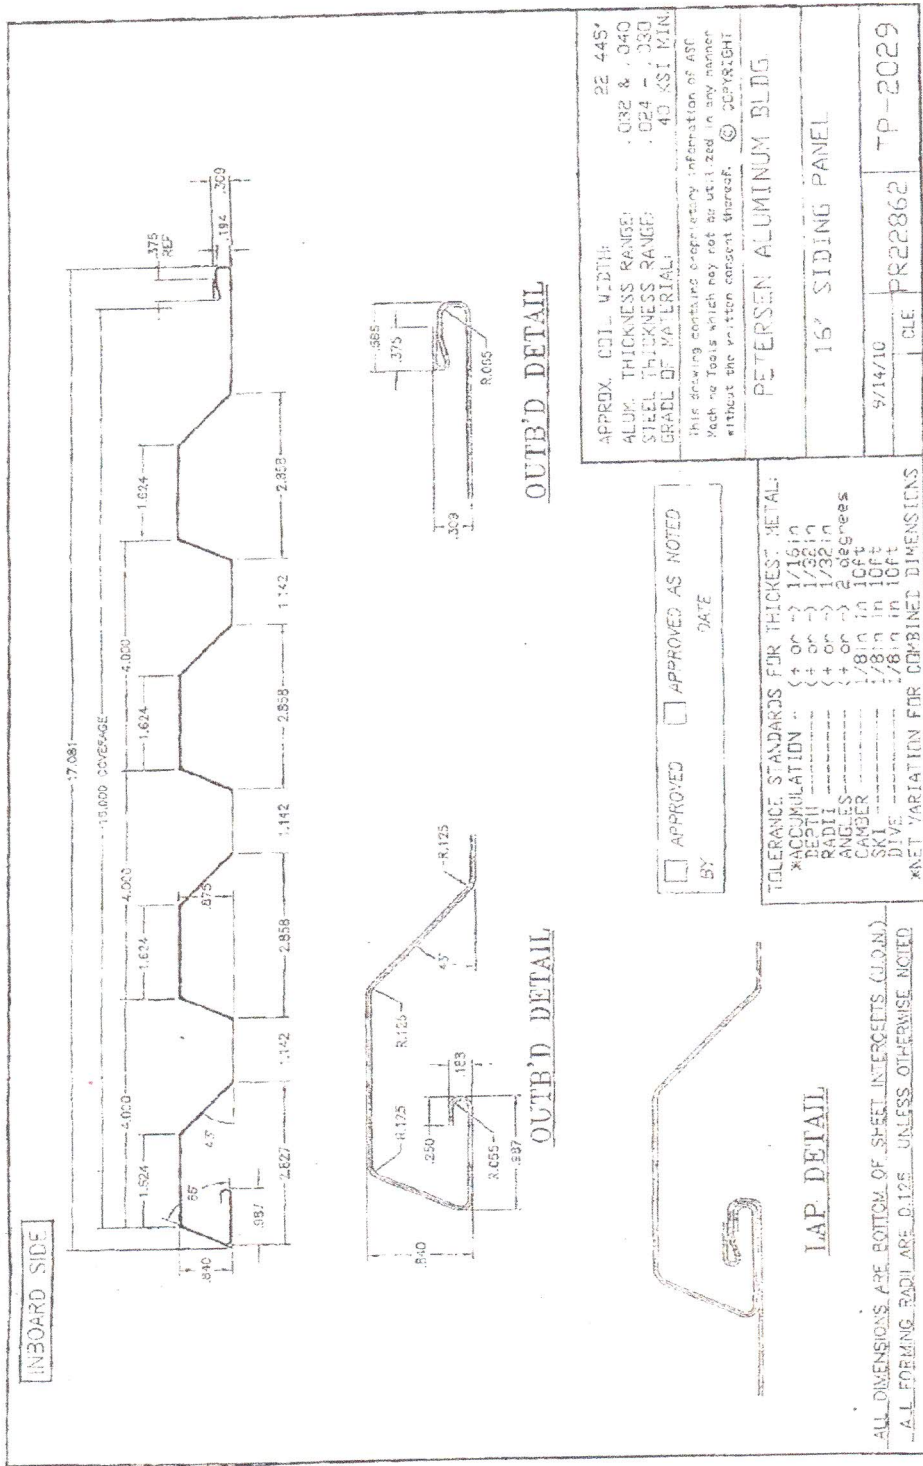

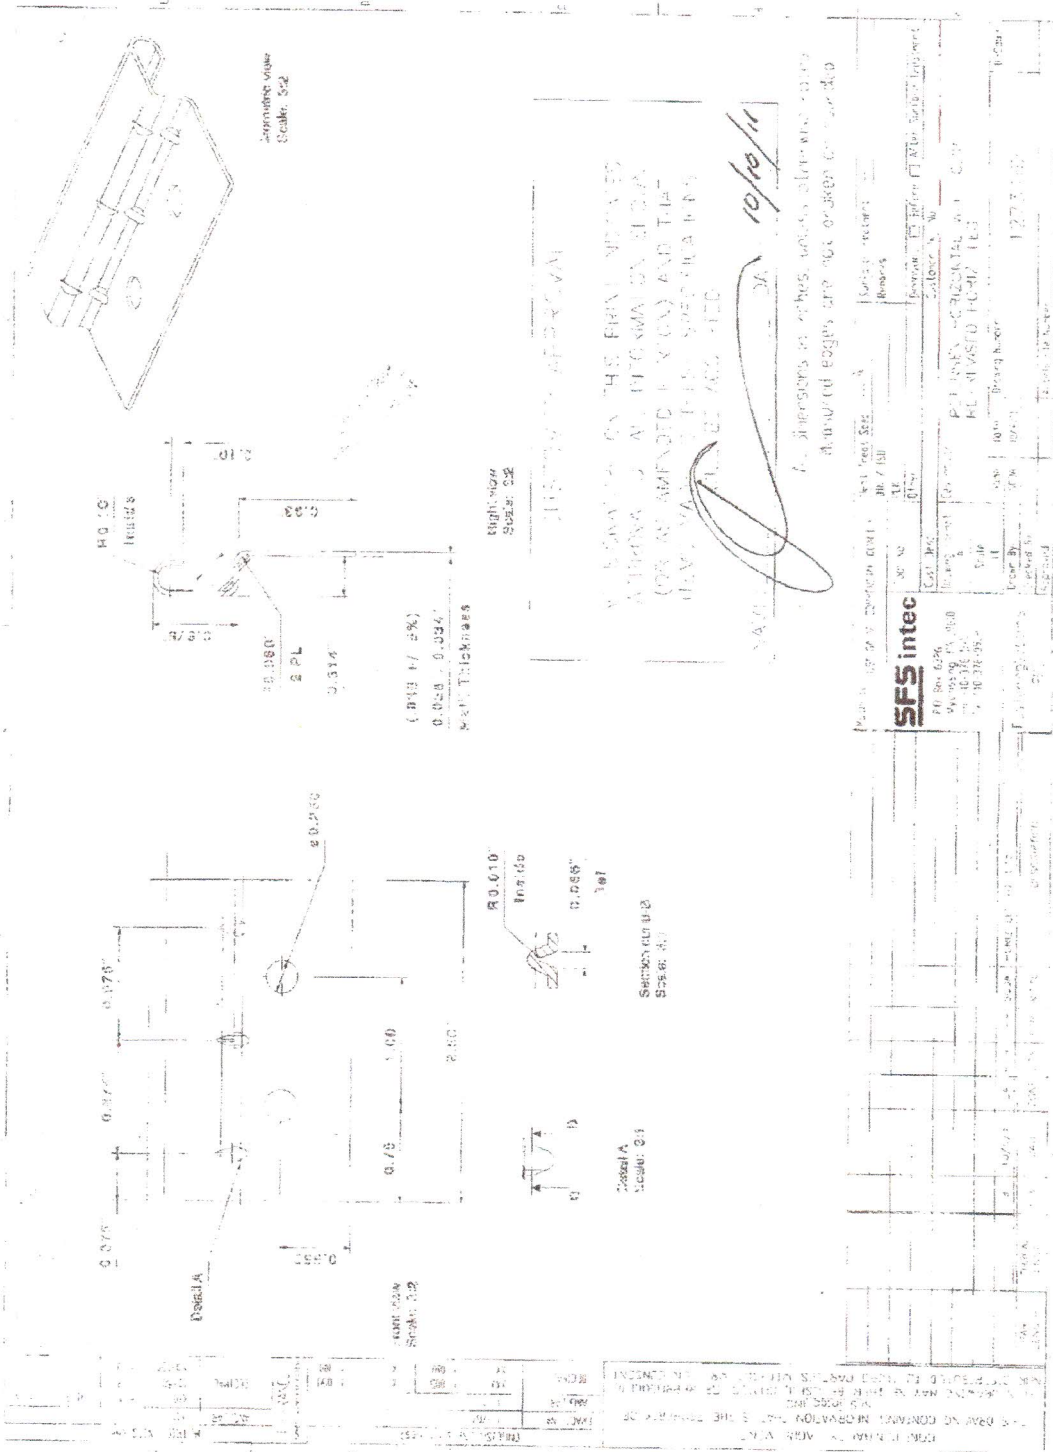

11/22/11 10/10/11

ALL DIMENSIONS UNLESS OTHERWISE SPECIFIED ARE IN INCHES. DIMENSIONS IN PARENTHESES ARE FOR INFORMATION ONLY. DIMENSIONS IN SQUARE BRACKETS ARE FOR INFORMATION ONLY.

1. Dimensions in inches, unless otherwise noted. Allotted tolerances are not to exceed 0.0010.

SFS intec 11000 40th Ave Dayton, OH 45424 Phone: 937-233-8800 Fax: 937-233-8801 Website: www.sfsintec.com		Part No. 11000 Rev. 01 Date: 10/10/11
Material: 304 SS Finish: As Purchased Heat Treat: 1035 F Plating: None Coating: None	Quantity: 100 Unit Price: \$0.00 Total Price: \$0.00	Order No. 11000 Ship To: 11000 Ship Date: 11/22/11

Project No. T348-11

TENSILE TEST REPORT

Client: Petersen Aluminum Corp.
1005 Tonne Rd.
Elk Grove Village, IL 60007

Test Date: December 15, 2011

Test Method: ASTM A370-10

Material Description: 16" Siding Panel, 24 ga Steel

Sample No.	Width (in)	Thickness (in)	Yield Load (lb)	Max. Load (lb)	0.2% Offset Yield Strength (psi)	Tensile Strength (psi)	Elongation (% in 2 inches)
0091-11	0.509	0.024	711.4	754.8	58,231	61,793	24.6

Equipment Used: Tensile Machine #QT7-061196-020
Caliper #081410113-1
Extensometer #10311744D
Micrometer #52-222-001